

DE

Warnung! Stromschlaggefahr!

Alle Anschluss- und Wartungsarbeiten sind von einer elektrotechnischen Fachkraft im spannungslosen Zustand durchzuführen.



Montagehinweis

Es ist unbedingt darauf zu achten, dass die bauseits verwendeten Befestigungsteile für das 5-fache Leuchtengewicht ausgelegt sein müssen.



Haftung

Der Hersteller übernimmt keine Haftung für Schäden, die durch unsachgemäßen Einsatz oder Handhabung entstehen.

Umwelthinweis

Das Produkt gehört am Ende seiner Lebensdauer nicht in den normalen Hausmüll, sondern muss gemäß WEEE-Richtlinie getrennt gesammelt und sicher entsorgt werden.



EN

Warning! Electric Shock Hazard!

Installation, repair and maintenance work may only be carried out by qualified personnel when the power system has been disconnected.



Note to installation

It is important to ensure that the mounting pieces or fasteners used on site must be able to hold 5 times the weight of the light fixture.



Liability

The manufacturer is not liable for damages caused by improper use or handling.

Environmental remark

This product does not belong in the normal household waste at the end of its lifespan, but must be collected separately in accordance with the WEEE Directive and disposed of safely.



 **LUDWIG**
LEUCHTEN

 **MADE IN GERMANY**

MONTAGEANLEITUNG

INSTALLATION INSTRUCTIONS

TRAGESCHIENE | SUPPORT RAIL – TR50



 **LUDWIG**
LEUCHTEN


Ludwig Leuchten GmbH
Geierswalder Straße 12
02979 Elsterheide | Germany

+49 (0)3571 4217 – 0
+49 (0)3571 4217 – 77

sales@ludwig-leuchten.de
www.ludwig-leuchten.de

Version Apr-22

TRAGESCHIENE | SUPPORT RAIL - TR50

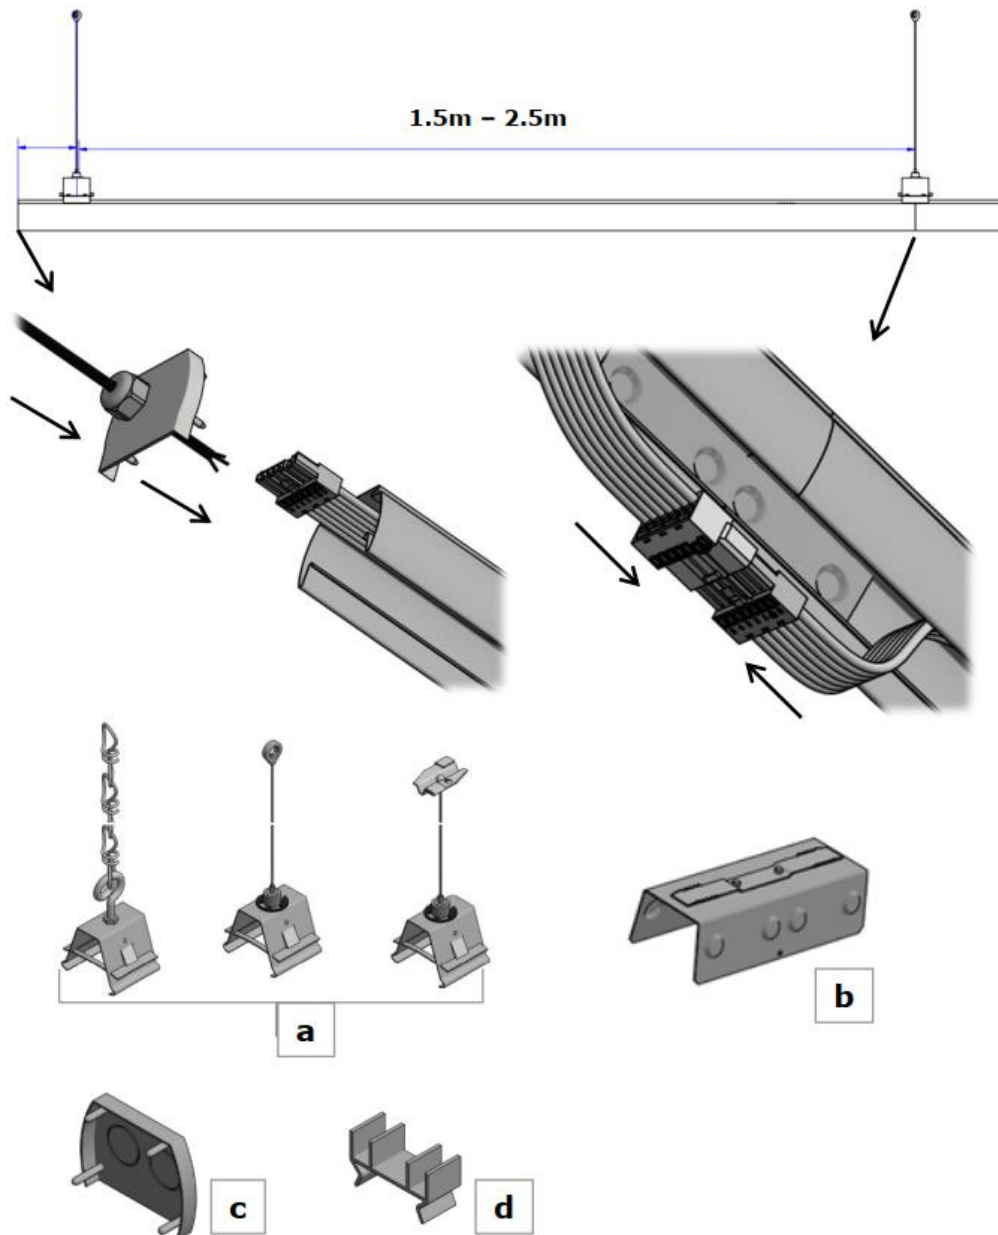

DE

Montageanleitung

Die Trageschienen dienen zur Zusammenstellung verschiedener langer Lichtbänder, die sowohl an der Decke montiert als auch mit Pendel abgehängt werden können.

Trageschienen (1lg, 2lg, 3lg).

L = 1530mm (1lg).

Für die Abhängung von Trageschienen sind aufsteckbare Schiebekralen für Rohrpendel, Ketten- oder Seilpendel zu verwenden (a).

Schiebekralle pro LB = 1 pro Einheit.

Abstand zur ersten Schiebekralle = 1,5m bis 2,5m.

Die Durchgangsverdrahtung wird als Kabelbaum mit der Einrast-Steckklemme in die Trageschiene eingedrückt und geerdet.

Kabelhalter verhindern das Durchhängen der Lichtbandverdrahtung.

Die Einspeisung in die trageschienenenseitige Durchgangsverdrahtung kann entweder direkt am WAGO-Steckerteil (siehe Kennzeichnung) oder durch ein separates zu bestellendes Steckerteil am vorhandenen Buchsenteil erfolgen.

Bei Trageschienen für asymmetrische Lichtbändeinsätze zeigen die angebrachten Hinweispfeile in die Abstrahlrichtung.

Zubehör:

Kupplung / Trageschienenverbinder (b)

Stirn- / Endkappe

Aufsteckbügel für Leitungen (d)

Technische Daten:

U: 230V / 50Hz

Schutzklasse: I

EN

Assembly Instructions

The support rails are used to put together various long light strips that can be mounted on the ceiling or suspended with a pendulum.

Support rails (1-line, 2-line, 3-line).
L = 1530mm (1lg).

Attachable sliding claws for tube pendulums, chain or rope pendulums must be used to suspend carrier rails (a).

Sliding claw per LB = 1 per unit. Distance to the first sliding claw = 1,5m to 2,5m.

The through-wiring is pressed into the mounting rail as a cable harness with the snap-in plug-in terminal and grounded.

Cable holders prevent the trunking wiring from sagging.

Feeding into the through-wiring on the mounting rail side can either take place directly on the WAGO plug part (see marking) or using a separate plug part on the existing socket part.

In the case of support rails for asymmetrical trunking inserts, the attached arrows point in the direction of radiation.

Equipment:

Coupling / mounting rail connector (b)

Forehead / end cap

Clip-on bracket for cables (d)

Technical information:

U: 230V / 50Hz

Protection class: I